
Research Activities of Enel Green Power in Geothermal

Ruggero Bertani Geothermal Center of Excellence Enel Green Power October 2014



エネル・グリーン・パワー社 エンジニアリング&建設部 地熱研究所 ルッジェーロ・ベルターニ

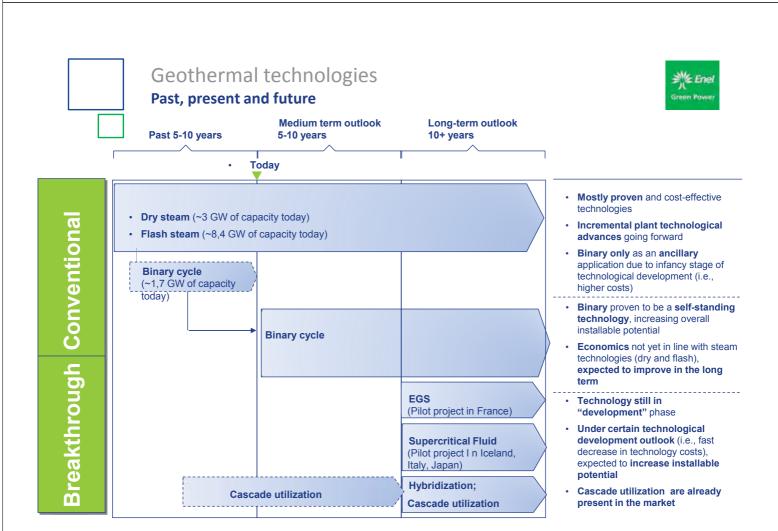

EGP Innovation Hybrid Plants: Biomass



Background & description


- · Previous studies showed the benefits of steam superheating
- · Coupling of biomass and geothermal generation is unique
- Cornia 2 is a 20 MW nameplate "standardized" geothermal power plant, currently operating at around 14 MW_e of gross output, due to the poor characteristics of the steam feed: 110 t/h saturated @ 5.2 bar and 153°C (steam saturation is due to chloride scrubbing)
- The project consists in repowering by means of steam superheating from 153°C to 370°C, with heat supplied by solid biomass combustion.
 Expected power increase: around 5 MW_e, with optimum utilization of existing installation and grid connection
- Favorable site characteristics (flat nearby terrain, availability of an industrial site for biomass storage and "boiler" installation, plenty of woods and agricultural lands around)
- Entirely renewable power generation, with lower unit CapEx and higher biomass utilization efficiency (around 35% vs. 20-25%) than a standalone biomass power plant (biomass-geo synergy)
- · Authorization was obtained in Sept. 2011



Hybrid Plants: Biomass



Hybrid Plants: Biomass

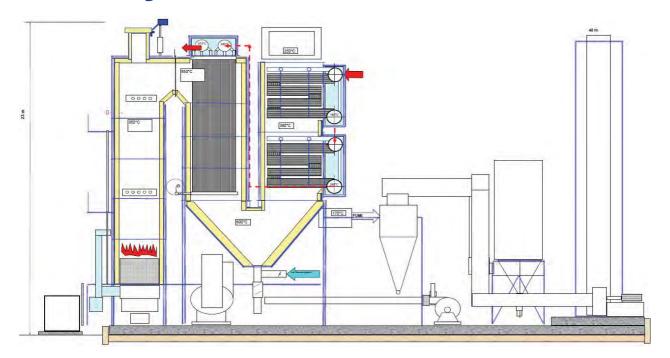



Hybrid Plants: Biomass



Site	Technology	Biomass type	Biomass need [kt/y]	Capacity [MWe]	
Cornia 2	Geothermal steam superheater with biomass firing by combustion grate	Forest & agricultural residues, power crops	43	4.8	
					Cornia 2 plant

Cornia 2 biomass repowering





EGP Innovation

Hybrid Plants: Biomass





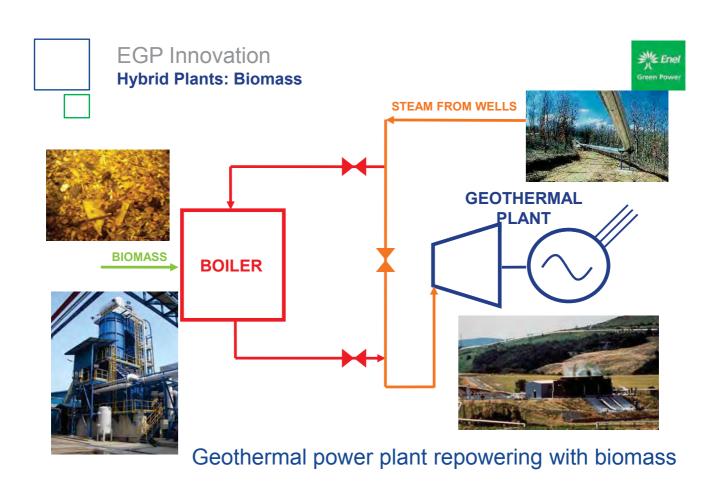

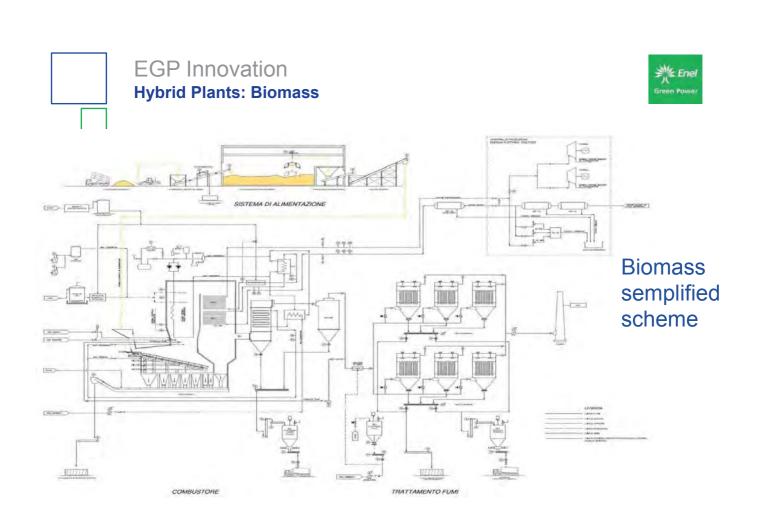








Project description and main data

Location	Cornia 2 geothermal power plant – Castelnuovo Val di Cecina (PI)
Plant data	Thermal capacity: 16 MWt Increased net electric capacity: 4.8 MWe
Plant description	Biomass storage and handling system Combustion grate for biomass Superheater boiler for geothermal steam Flue gas treatment (including bag filters) Existing steam turbine (to be refurbished) and generator Existing cooling towers
Biomass	Geothermal superheated steam – 110 t/h @ 4.7 bar, 370°C 43 kt/yr at 10.5 MJ/kg 100% short range forest and agricultural residues as well as powercrops
Equivalent operating hours at full load	7,800 hr/y
Total Net Energy production	37,440 GWh/yr
Grid connection & Area	Currently operating geothermal power plant Cornia 2

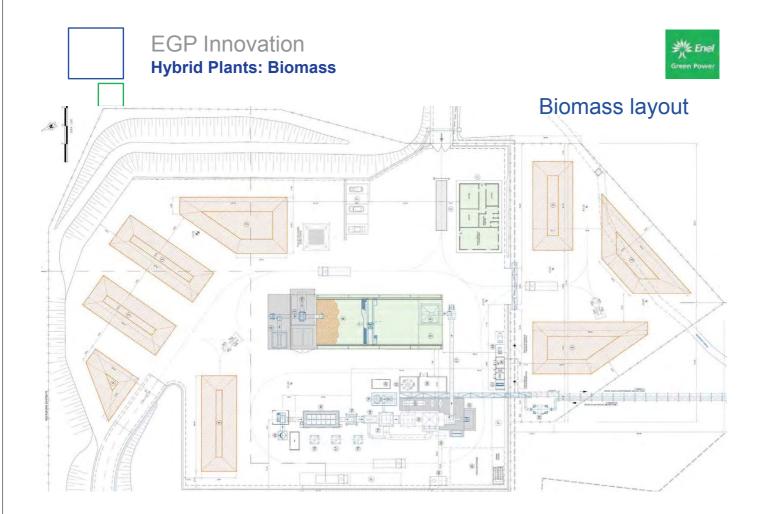

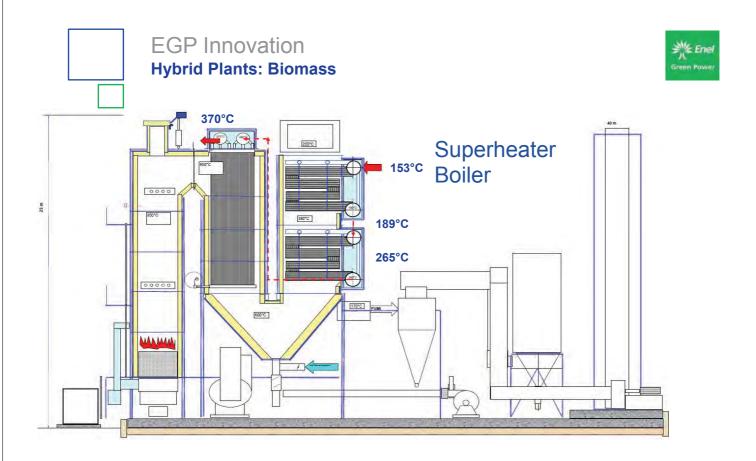

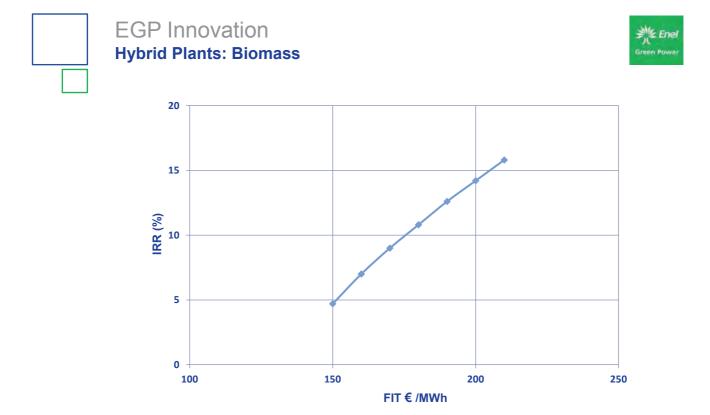

Investment profitability

EGP Innovation
Hybrid Plants: Biomass



Biomass repowering


- The boiler superheater is a non-standard equipment (low pressure steam requires large tube area to minimize steam pressure drop; high metal surface temperatures must be avoided using low flue gas velocities, notwithstanding the low heat exchange rate of the steam)
- Possible schemes with diathermal oil heat exchange and final superheating in the boiler or with total heat exchange in the boiler; the latter was chosen on the basis of CapEx and O&M considerations
- Turbine maximum rated temperature was 280°C; however, the
 manufacturer stated that operating temperatures up to 380°C can be
 reached with minor modifications (including removal of the first reaction
 stage and substitution of the impulse control stage)
- Optimization of the existing assets entailed the transformation of the existing powerhouse of the dismissed Cornia 1 plant in a short term biomass storage facility (with a high speed bridge crane for loading and unloading)
- The Italian RES incentive scheme was changed in July 2012, reducing the FIT from the range 190÷280 €/MWh to 125 €/MWh, thus making the investment less profitable





Hybrid Plants: Solar



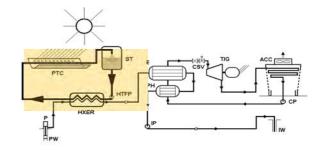



Hybrid Plants: Solar




Hybrid Geothermal - PV



- ✓It is the first hybrid PV solar geothermal application in the world combining the continuous generation capacity of binarycycle, medium-enthalpy geo power, with the peak capacity of solar power;
- ✓ Still Water (33 MW) geo plant is one of the world largest binary cycle plants with "Closed-loop" system;

Hybrid Geothermal - CSP

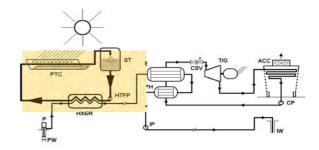

- √ World's first plant integrating CSP with a Geo binary plant will be developed in Nevada;
- ✓CSP will integrate Geothermal gross capacity in order to maintain appropriate thermodynamic range of operation of isobutane;
- √Hybrid Geo-CSP plant aimed to flatten hourly variations and increase production;

PV hybridization project already operational in the US





EGP Innovation

Hybrid Plants: Solar



In western USA, plentiful solar radiation & geothermal

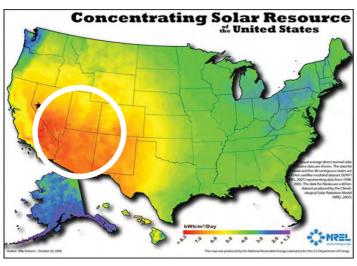

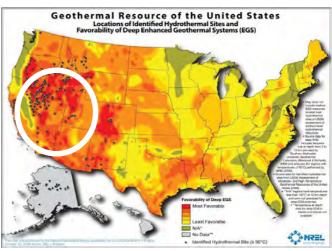



Hybrid Plants: Solar



Salt Wells and Still Water are the world largest binary cycle plants They are the benchmark in binary geothermal energy generation

- A binary system with two fluids, hot water from underground wells heats an organic fluid and turns it into a vapor that makes the turbine generate power.
- They are "Closed-loop" systems that continually replenishe the geothermal resource used in the power generation process, without use of other Natural Resources (water)
- They will also be **the first hybrid solar-geothermal applications** in the world.







EGP Innovation

Hybrid Plants: Solar



STILLWATER PLANT











STILLWATER PLANT

Working fluid =
isobutane
Active production
wells = 7
Units = 2, each
with 2 turbogenerators
Cooling = air
cooled condenser






EGP Innovation

Hybrid Plants: Solar



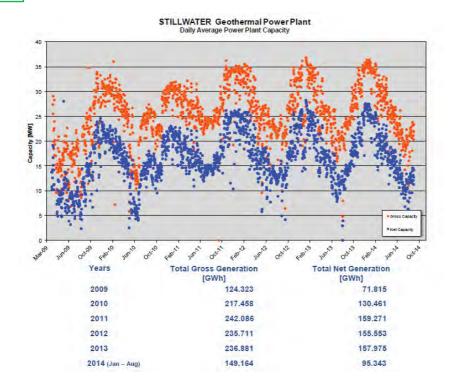





STILLWATER PLANT

- 2009 began w/ nominal capacity 33.1 MW.
- 2012 26 MW of photovoltaic capacity added.
- Production impaired during warm weather, because of dry cooling.
- Geothermal brine temperature lower than design, so power island underutilized.
- Integration with Solar designed to increase the power output.



EGP Innovation

Hybrid Plants: Solar

Stillwater Solar Geothermal Hybrid Project PV





- World's first solar/geothermal hybrid project combines the continuous generation capacity of the medium enthalpy geothermal binary cycle with the peak capacity of solar power thus allowing for synergies to be explored.
- Integrates 26 MW of solar photovoltaic capacity to EGPNA's operating 33 MW Stillwater Geothermal Project
- Consists of over 89,000 polycrystalline silicon PV panels built on 240 acres. It will generate enough energy to meet the needs of 16,000 American households.
- In 2012, this state-of-the art plant won EGPNA the Geothermal Energy Association Honor Award for Technology Advancement which recognizes companies that develop innovative or pioneering technology to further geothermal development.




Hybrid Plants: Solar



Enel Green Power

Addressing key risks

- Thermal efficiency in a geothermal unit lowest during the hottest & sunniest times of the day
 when solar PV is most productive
- The result, stabilized production
- Successful application of this concept paves way to address key risks including resource risk and generation intermittency

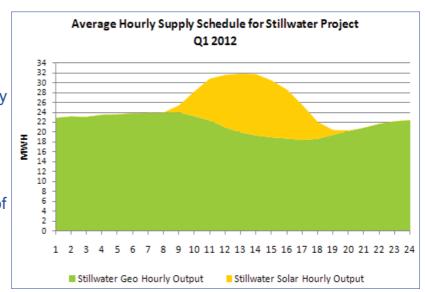



EGP Innovation

Hybrid Plants: Solar



Development

Stillwater Solar Geothermal Hybrid Project PV



- July 2011: Construction begins
- December 2011: Construction completed on 24 MW
- March 2012: 26 MW fully commissioned
- More than 150 construction workers employed onsite
- Created new opportunities for suppliers









Stillwater Solar Geothermal Hybrid Project PV

- The solar plant not only sits next to the geothermal plant, it is integrated with the geothermal plant and provides the energy to run the geothermal plants auxiliary loads.
- The integration also includes the Control System, Electrical Protection and Island Mode capability, Fire Detection/Protection Schemes, Electrical Interconnection, and the use of a common Operations and Maintenance staff.
- Alternatively, the geothermal plant provides auxiliary power to the solar plant when there is no sunlight thus eliminating the need for back feeding power from the utility.
- The implications for the renewable industry are major. This first-ever geothermal-solar hybrid power plant demonstrated that the concept works to combine the strengths of different renewable technologies and create a better whole.






- Minimize geothermal technology problems and produce more electricity without expanding the use of the geo-resource
- Improve performance over a pure geothermal system
- More cost-effective than standalone solar facilities, also thanks to medium temperature and low-cost solar collectors
- Enhancing the thermal efficiency in the geothermal unit during the hottest and sunniest times of the day or year, through the solar plant
- Stabilizing production during the day, enabling a more loadfollowing production profile, thanks to geothermal





Stillwater Solar Geothermal Hybrid Project CSP

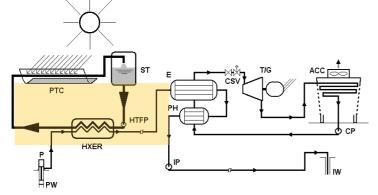

	Condizioni nominali di funzionamento	Prestazioni annuali
DNI	900 W/m2	2460 kWh/m2/yr
Input Solare	28.8 MW	78,930 MWh
Input termico addizionale al ciclo	17 MW	32,250 MWh
Output elettrico incrementale ⁴	2 MW	3960 MWh
Efficienza campo solare	59 %	41 %
Efficienza incrementale ORC	12 %	12 %
Efficienza incrementale globale Errore. Il segnalibro non è definito.	7 %	5 %

Tabella 2 - Prestazioni incrementali della configurazione ibrida geo-solare.

Solar Field Area: 20 acres

Collectors' Area: 32,000 sqm


HTF temp at heat exchanger inlet: 400°F (205°C)

5-10% of Geothermal project gross capacity in order to maintain appropriate thermodynanmic range of operation of isobutane

Hybridization CSP + Geothermal





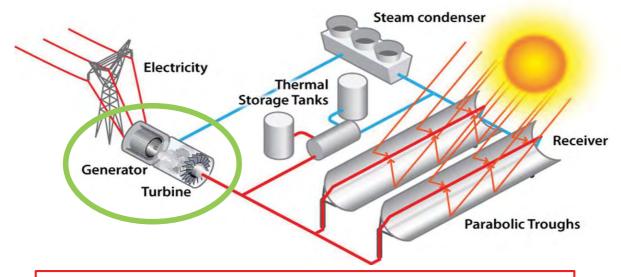

Two Issues:

- 1. Intermittent (no power at night or on cloudy days)
- 2. Requires power block which is expensive





Stillwater Solar Geothermal Hybrid Project CSP

Advantages of Integration

Relative to Geothermal ORC:

- Increase the maximum temperature of the working fluid, resulting in a higher efficiency of the ORC;
- Stabilize production during the day, when the air cooled ORC suffers from a higher ambient temperature, by increasing thermal input;
- Compensate reservoir temperature depletion during the years (adding solar collectors) without reducing power production;
- Reduce investment risk from uncertainty of the geothermal resource.





Advantages of Integration

Relative to Concentrating Solar Power (CSP):

- Stabilize power generation without using thermal storage or a back-up fuel source;
- Reduce capital costs because the power island is shared, thermal storage is not strictly required, the low ORC operating temperature allows use of less expensive lower temperature (400°F/ 204°C rather than the typical 750°F/ 400°C) solar collectors;
- Reduce thermal losses (increase efficiency) of the solar collectors due to the low working temperature.

EGP Innovation

Hybrid Plants: Solar




Stillwater Solar Geothermal Hybrid Project CSP



Under Construction





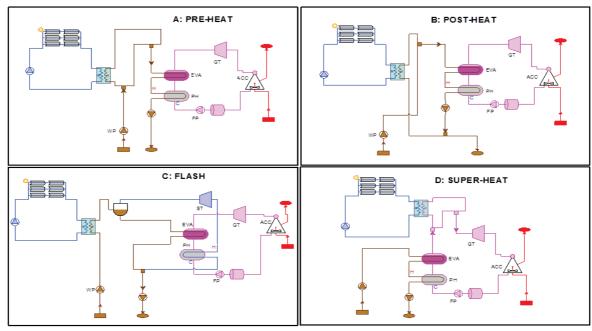


Integration 4 Ways





Stillwater Solar Geothermal Hybrid Project CSP

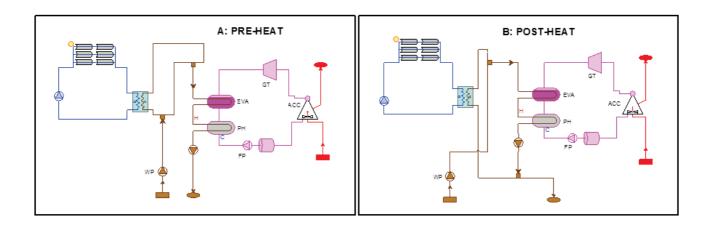

Options A and B do not interfere with the existing power block.





Comparison Assumptions

Design Conditions:

- Aperture Direct Normal Irradiance = 900 W/m²;
- Ambient temperature = 21°C;
- Useful heat from solar source at design conditions = 17 MW-th.

Annual Conditions:

- Average daily Direct Normal Irradiance (DNI) = 5.92 kWh/m2-d;
- Average Ambient Temperature = 10.7°C.

Hybrid operating strategies - how many turbines are in operation at a given ambient temperature.





Stillwater Solar Geothermal Hybrid Project CSP


Parameters of Comparison


Case	Ambient	Net Thermal	Turbine
	Temp	Input (% of	Expanders
		17 MW-th)	in Service
1	40°F (4.4°C)	25	4
2	53°F (11.7°C)	50	3
3	63°F (17.2°C)	75	3
4	70°F (21.1°C)	100	2

EGP Innovation Hybrid Plants: Solar Stillwat




Stillwater Solar Geothermal Hybrid Project CSF

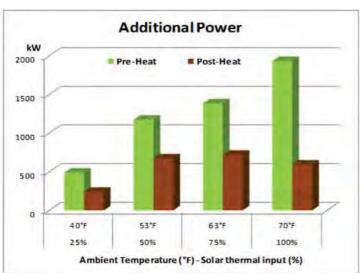

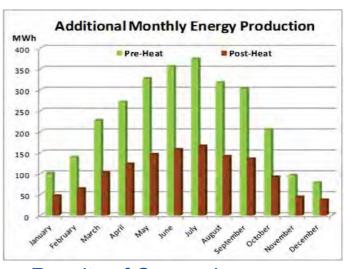

Results of Comparison

- Pre-Heat produces about 2x the incremental power and energy as Post-Heat.
- · Pre-Heat selected for CSP integration.

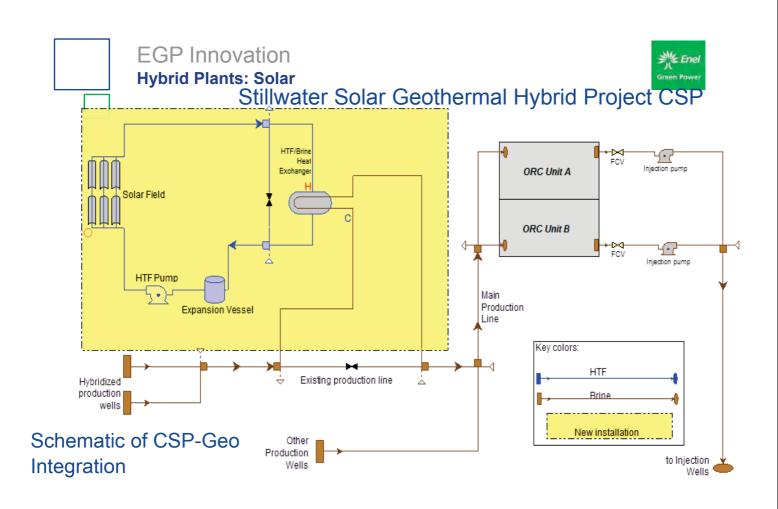






CSP Solar Field

- 17 MWth
- 24,000 m² of parabolic trough collectors
- 11 parallel loops
- Heat Transfer Fluid (HTF) is demineralized water with a corrosion inhibitor added
- Solar inlet temperature 300°F/149°C
- Solar outlet temperature 390°F/ 199°C

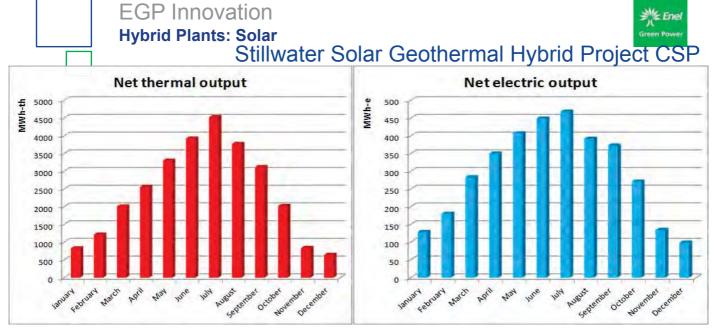

Annually

Modeled Output of Solar Field

- Solar energy in = 56,346 MWh
- Thermal out (net) = 28,746 MWh
- Solar electric out (net) = 3,537 MWh-e






Binary Plants





EGP Innovation

Binary Plants

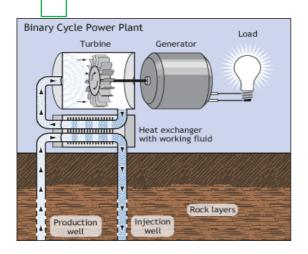



- Binary Cycle can operate with fluids as low as 165°F (74°C)
- Can use dry cooling
- Recent advancements in binary cycle have opened up a lot more geothermal resource

Two Issues:

- 1. Actual temperature of geothermal brine frequently declines over time.
- 2. As ambient temperature increases, efficiency of air cooling declines can impair plant production by 70%.



Binary Plants

影 Enel Green Power

Technology Advantages

- ·Can exploit low temperature heat sources.
- Most equipment can be obtained from a variety of suppliers.
- •Negligible emissions from NCGs
- •Plant can be constructed in shops on skid mounted modules for easy shipping and field assembly
- •All of the water drawn from the reservoir is return. Source generally have a higher useful life.

Technology Disadvantages

- · Lower energy conversion rate than steam turbine plants.
- More process equipment thus requiring more maintenance effort and expense.
- Brines may have high concentrations of silica and/or Calcium salts which can cause troublesome scaling requiring frequent clean-ups of heat exchangers and wells.

Main Equipment Suppliers

Turbine/Expanders: Rotoflow; Elliott Turbines

Texas Turbines; Mafi-Trench Air Products; Ormat, Turboden

Generators: GE; Alstom; Siemens, Kato

Condensers: Marley; Aerofin; BAltimore Coil


Economics

Power Plant Construction Cost:

\$2,000 - \$3,000 / kW

O&M Cost (direct): \$15 - \$20 /MWh


Typical "Binary Cycle" Geothermal Power Plant

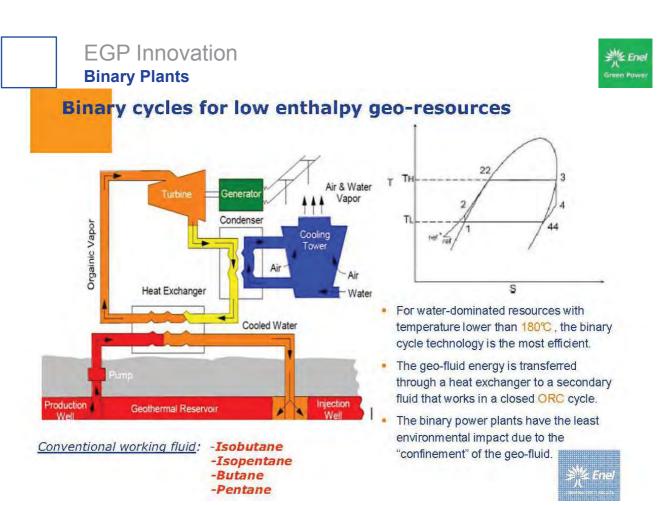





Innovation in binary cycle technology

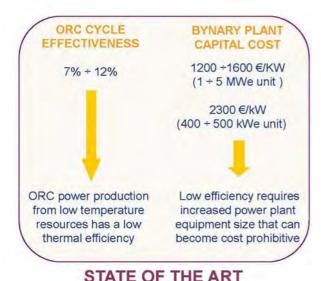

INNOVATION MAINSTAYS

ENHANCED PERFORMANCES & OPERATIONAL FLEXIBILITY

- To upgrade geothermal resources exploitation (electric generation more profitable)
- To better match the intrinsic characteristics of geothermal reservoirs
- To avoid performance decline due to the natural resources depletion and temperature drop





The objective of a multi-year collaboration between ENEL, the MIT, the Politecnico di Milano and TURBODEN is to evaluate power conversion options for geothermal applications and to propose designs for an innovative, cost-effective binary power plant for geothermal applications.

The design is intended to be sufficiently flexible and robust to utilize low-to-moderate temperature resources ranging in temperature from 130 to 160°C, or higher, while maintaining close to its optimum thermodynamic performance.

Enel Development of Binary Cycle Technology

Geothermal Electricity Plant: Innovative Design





The project aims to develop innovative electric generation systems to upgrade the exploitation low enthalpy geothermal resources.

ENHANCED PERFORMANCES

 to upgrade geothermal resources exploitation thus making the electric generation more profitable


GREATER FLEXIBILITY

- to better match the intrinsic characteristics of geothermal reservoirs
- to avoid performance decline because of the natural resources depletion and temperature drop

INNOVATION

Optimization of low enthalpy geothermal resources exploitation


Geothermal Electricity Plant: Innovative Design

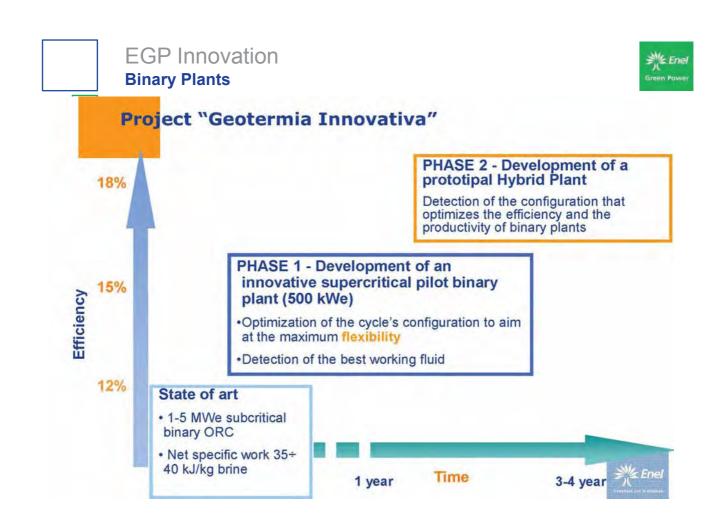





- To develop an advanced, supercritical, ORC technology in order to improve ENEL's geothermal production from low enthalpy geothermal resources worldwide (with a specific focus to USA).
 - Net specific work > 44 kJ/kg brine (~ +30% compared to actual technology).
 - High operation flexibility (capability to work with high performances in a wide range of brine temperatures).
 - Reduced investment cost.
- To demonstrate an advanced ORC at the pilot scale (500kWe).
 - Cycle thermodynamic performance.
 - Operating flexibility.
 - Component design and scale-up criteria (with a particular focus on turbo expander).
 - Component reliability during long term operation (some thousands hours).
- To evaluate the feasibility to increase the productivity of ENEL's ORC geothermal plants in the USA by means of integration with solar energy.

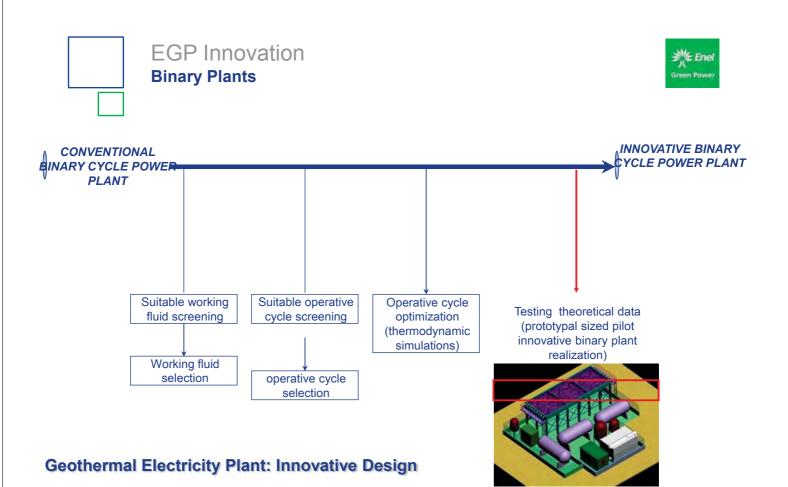



Binary Plants




Cycle optimization and working fluid selection


· Cycle modelling


- Sub-critical cycles (saturated, superheated)
- Super-critical cycles

· Working fluid screening criteria

- 6 Hydrocarbons tested
- 4 Refrigerants tested









EGP Innovation

Binary Plants



Constraints of the model and cycle optimization criteria




OPTIMIZATION VARIABLES

- · Working fluid mass flow rate
- Working fluid turbine inlet pressure
- Working fluid condensing pressure

PERFORMANCE INDICATORS

 Utilization efficiency



- Thermal efficiency
- $\eta_{th} = \frac{W_{net}}{Q_{in}}$

MAIN INPUT DATA

Brine inlet temperature: 100℃ ÷ 200℃ Brine reinjection temperature: ≥70℃ Cooling water: NOT AVAILABLE

Geothermal fluid mass flow: 100 kg/s
Dead-state temperature (Air ambient temperature): 20℃

Turbine isentropic efficiency:

85% for fully-vapor expansions


<85% when liquid is present (calculated from the Baumann equation)

Turbine exit vapor quality: 90%


Pump efficiency: 80%


Binary Plants


Subcritical vs. Supercritical Cycles



condense








EGP Innovation

Binary Plants




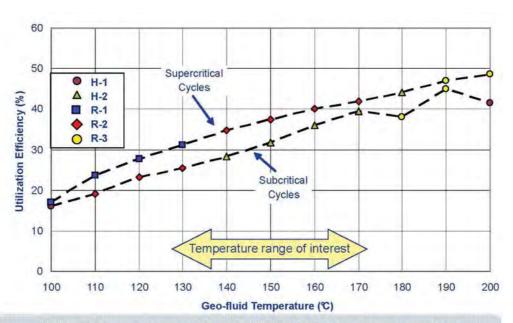

Supercritical cycles provide higher utilization efficiency for the whole geo-fluid temperature range, resulting in 23% max. increase in net power.


EGP Innovation Binary Plants



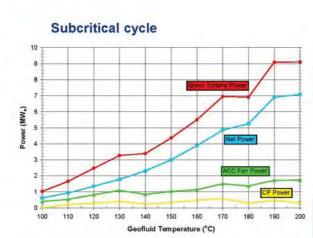

Power, MW	H-1 @ 100℃	H-2 @ 150℃	H-1 @ 200℃
Gross	1.03	4.37	9.12
Parasitic losses	40%	31%	22%
Net	0.62	3.00	7.07


Supercritical cycle



Power, MW	R-1 @ 100℃	R-2 @ 150℃	R-3 @ 200℃
Gross	1.41	5.43	11.23
Parasitic losses	53%	34%	26%
Net	0.66	3.56	8.30

EGP Innovation

Binary Plants



Plant type: geothermal prototype with supercritical cycle

Customer: Enel Green Power

Location: Livorno, Italy

Heat source: hot water at 150°C nominal **Cooling device:** 'dry & spray' condenser

Total electric power: 500 kW_{el}

Working fluid: refrigerant (non flammable)










Binary Plants



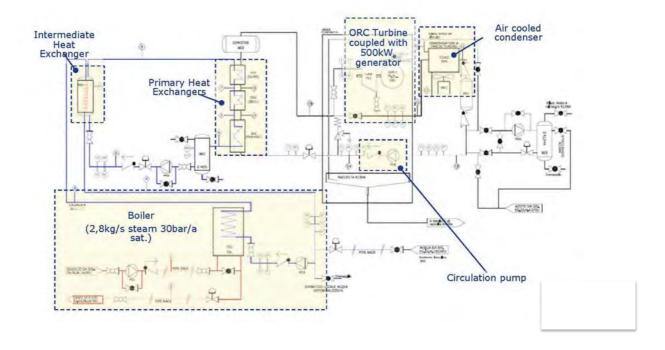



Binary Plants





- •COD 20-3-2012
- •Calibration and initial performance tests
- August: final set up with improvement in heat exchangers
- Long run test
- •Performance tuning with manufacturer
- Preliminary results are promising


Geothermal Electricity Plant: Innovative Design

Experimental campaign – ORC power plant prototype realization




EGP Innovation Binary Plants



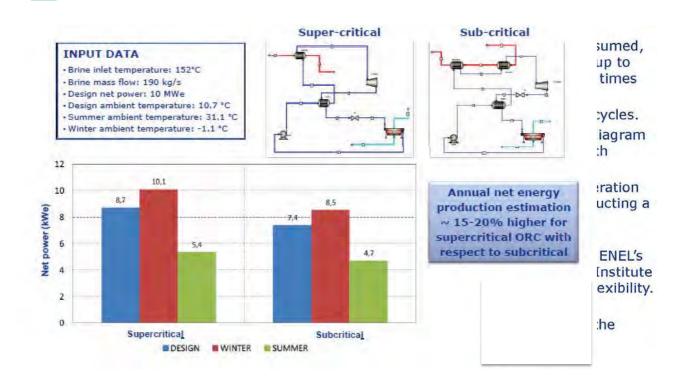






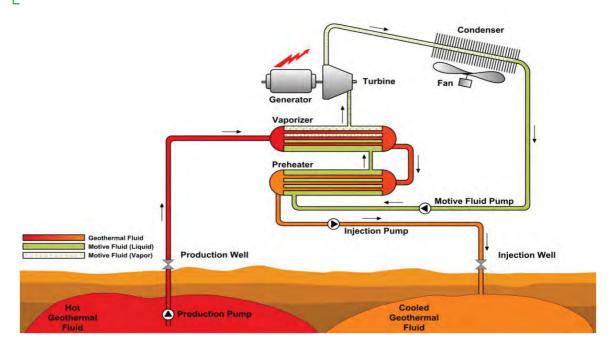

New Project: Cove Fort, Utah





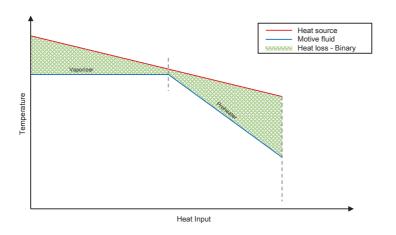

Power production potential with simple binary unit: 23±1 MW

New Project: Cove Fort, Utah




Binary Plants



Two Level Binary Cycle Geothermal

Integrated Two-Level Binary Geothermal Power Plant (ITLU)

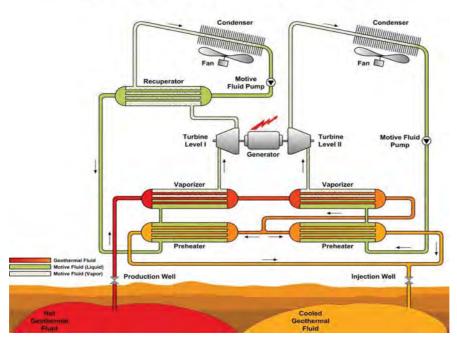


New Project: Cove Fort, Utah



EGP Innovation

Binary Plants



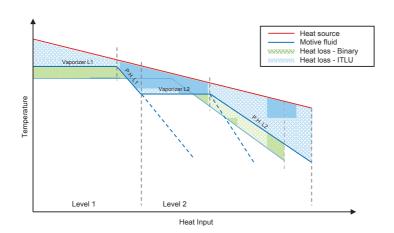


Power production potential with simple binary unit: 23±1 MW

Power production with ITLU: 26.4 MW ≈ 15% Improvement over simple binary unit!

EGP Innovation Binary Plants



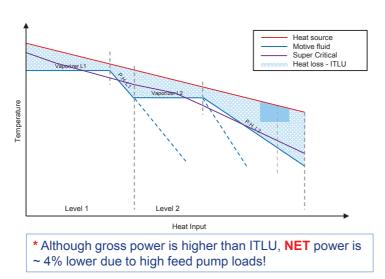

Power production potential with simple binary unit: 23±1 MW

Power production with ITLU:

26.4 MW

≈ 15% Improvement over simple binary unit!

Power production with Super Critical unit: 28.3* MW

New Project: Cove Fort, Utah

EGP Innovation Binary Plants





New Project: Cove Fort, Utah







New Project: Cove Fort, Utah

EGP Innovation






New Project: Cove Fort, Utah

Binary Plants



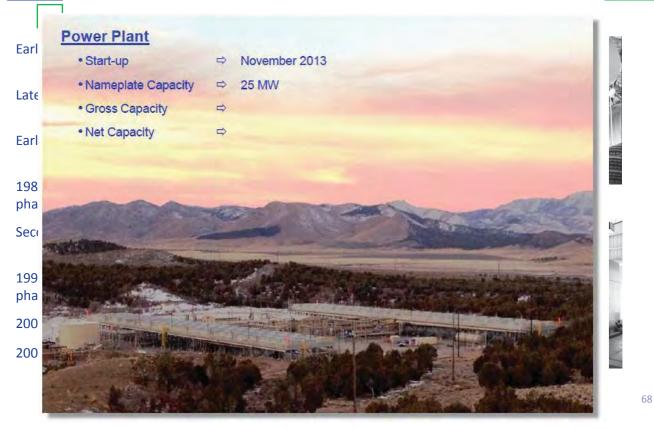




EGP Innovation

Binary Plants



- Water dominated high temperature geothermal reservoir >300°C
- At 20 bar well head separation unitsM hot water reinjection of about 250 t/h;
- Silica presence: not possible to allow excessive water cooling;
- SOLUTION: a second flash at 5 bar, producing 20- 30 t/h of steam at 5 bar and 160°C

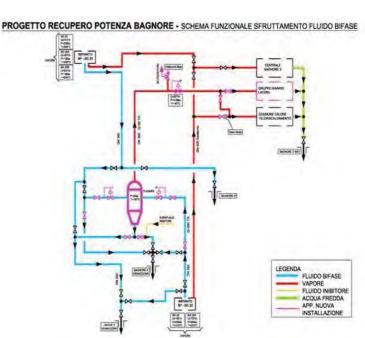


New Project: Mount. Amiata, Italy



EGP Innovation Supercritical fluids




Supercritical fluids

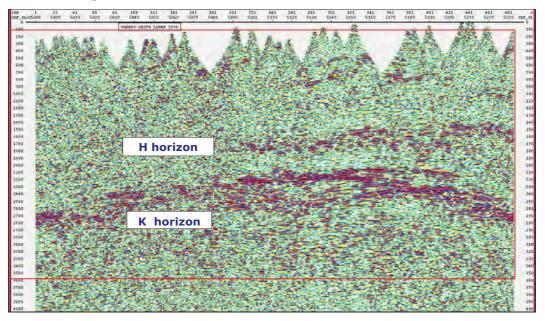





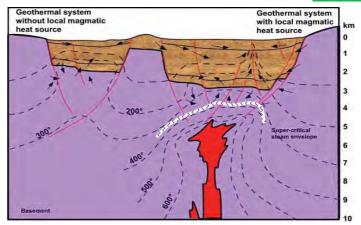

High heat flow conditions ⇒ rift zones, subduction zones and mantle plumes.


Thick blankets of thermally insulating sediment covering a basement rock that has a relatively normal heat flow

→ lower grade

Other sources of thermal anomaly:


- Large granitic rocks rich in radioisotopes
- Very rapid uplift of meteoric water heated by normal gradient






The areal extension Larderello the exploited area increased till the '70. when the external boundaries of the system have been reached. No new development was done in the last 30 for extending the surface of the field.

Larderello A success history

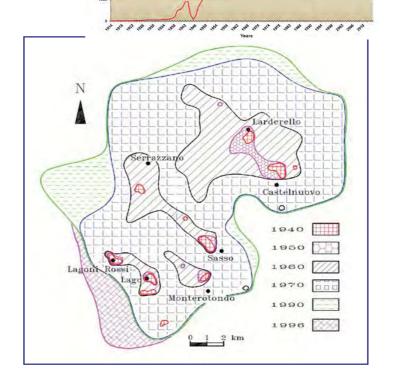




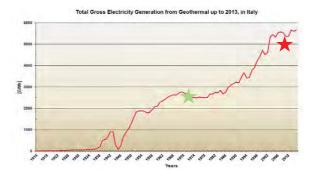



The deep exploration the Larderello system started after the '70, after the exploitation (which still is on going!) of the shallow reservoir [2], drilling into the metamorphic basement down to 4-5 km depth [3]. Today the production is stabilized from the combined effect of reinjection and deep wells. No new increasing ramp is expected.

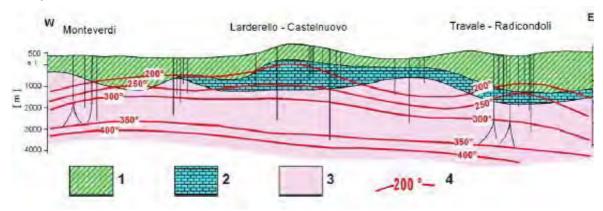


EGP Innovation

Supercritical fluids




- 1) H Horizon: it is relatively shallow (2500-3500m), non-continuous, and it represent a target for deep wells in the metamorphic basement, with a significative permeability, even if not-homogeneous
- 2) K Horizon: it is deeper (3000-10000m), almost continuous, present in all the area of

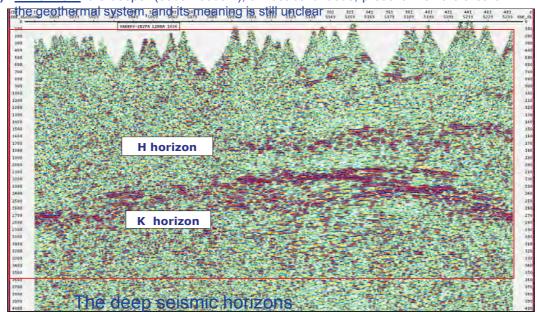





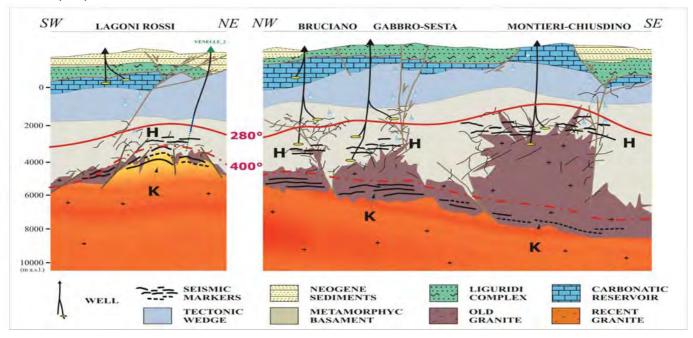

Drilling into the K horizon

will open the possibilities of exploiting the deep supercritical fluid that can be hosted in the young granites, with a new development phase for the Larderello field.



EGP Innovation Supercritical fluids



THE PROJECT

Deepening Venelle 2 Project

Our proposal is aimed to the exploration of the K horizon, in order to investigate the presence of supercritical fluids and their characterization, physical and chemical. The project will be realized through the deepening of an existing dry well Venelle 2 in Larderello, which has been halted quite near to such a target.

The thermodynamical conditions could be very challenging and rich of perspectives:

- •Temperature > 450°C
- •Pressure >250 bar
- Supercritical fluids
- Chemical components

EXPECTED OUTCOMES

- ➤ Well with high specific productivity = up to 30 MW per single well
- **≻Closed loop production**
- ➤ Reassessment of the reserves in our leases
- ➤ Possibility of high value chemical component extractions
- ➤ Technological and scientific challengefruitful international cooperation

EGP Innovation
Supercritical fluids



Deepening Venelle 2 Project

WHY NOW?

Supercritical fluids utilization is important for a new growing phase of the geothermal development in Italy, using the important source of funds from UE (Horizon 2020) and the opportunity of an international cooperation.


Supercritical fluids have been investigated by Japan and Iceland, with controversial results.

There is a strong international interest in such a research frontier.



Worldwide a few attempts at drilling in very high temperature/pressure conditions:

- •San Pompeo 2 well in Italy: drilled by EGP in 1979, with the target of a deep fractured layer inside the metamorphic basement in Larderello. At about a 3 km depth it produced a very different fluid from earlier experiences in the exploited hydrothermal reservoir. Its pressure was above 24 MPa (five times higher than the standard) and the extrapolated temperature exceeded 400°C. The well was closed after a hydrogen gas explosion, which severely damaged the drilling string. Sampling of the deep fluids highlighted the important presence of gases, and a strongly corrosive environment.
- •Deep Seated Geothermal Resources Survey well in **Japan**: drilled in **1994-1995** by NEDO to investigate the characteristics of the deep-seated part of the **Kakkonda** geothermal field, one of the largest liquid dominated geothermal systems in Japan. When a depth of 3.7 km was reached, the operation stopped for safety concerns, principally due to a H₂S discharge and difficulty in controlling the drilling. The inferred temperature was above 500°C.
- •IDDP-1 well in **Iceland**: in **2009** the drilling of the first IDDP well, designed to reach a 4.5 km depth, was attempted at **Krafla**. The drilling terminated abruptly at only a 2.1 km depth when the drill bit hit 900 °C hot rhyolitic magma. The IDDP consortium decided to complete the well as a subcritical well designed to produce from the contact zone of the intrusion, which in its first few months to operations has proved to be highly productive. A new well is planned.

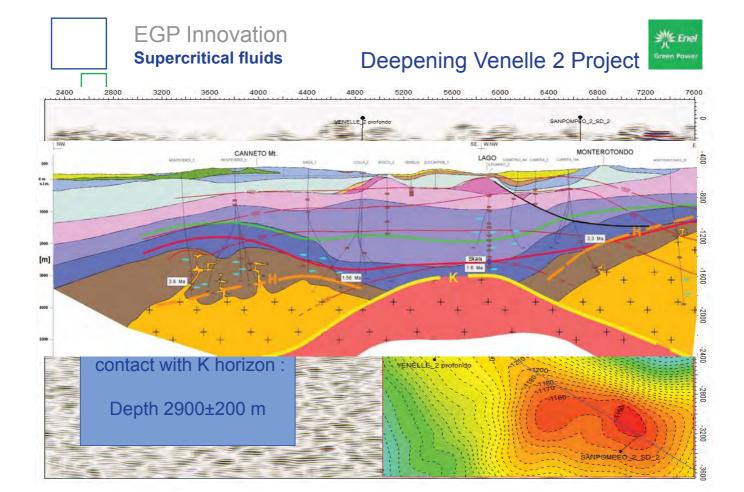




Supercritical fluids



Deepening Venelle 2 Project

- •Demonstrate the feasibility of safely drilling a deep super-critical geothermal well, by identifying technical problems created by super-critical conditions, solving these problems by developing improved drilling procedures, equipment and well design, and extending the Venelle 2 well into a very high temperature formation.
- •Reduce the technical and financial risks of drilling and exploiting deep geothermal wells by improving knowledge of the physical and chemical conditions in deep geothermal formations. Characterisation of the physical and chemical properties of deep crustal fluids and rocks will be performed. In addition to standard logging during drilling, a novel measurement tool will be developed and used to measure pressure and temperature in super-critical conditions. The knowledge gained will be disseminated in industry related channels.
- •Reduce pre-drill uncertainty in the exploration of deep geothermal wells by applying the latest seismic processing, imaging and interpretation technology for exploring the supercritical reservoir prior to drilling. The seismic methods will be evaluated and calibrated based on results obtained during drilling.
- •Investigate the potential of improving the competitiveness of geothermal power, the possibility of exploiting chemicals from deep crustal conditions will be also addressed during the project.

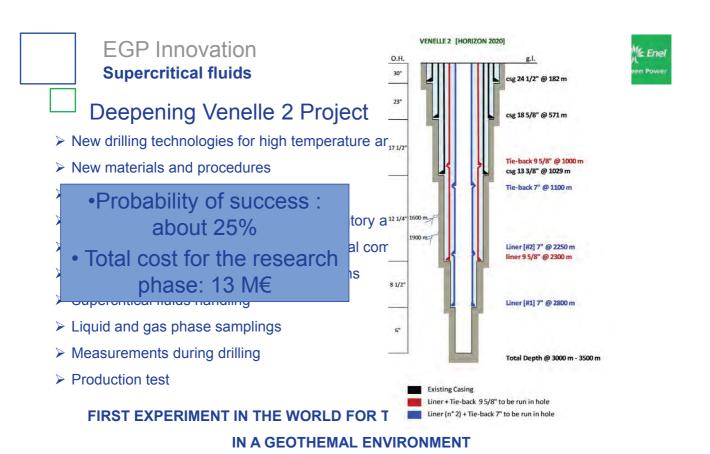



Supercritical fluids



Deepening Venelle 2 Project: DESCRAMBLE

The "Drilling in dEep, Super-CRitical AMBient of continental Europe" (DESCRAMBLE) project proposes to drill in continental-crust, super-critical geothermal conditions, and to test and demonstrate novel drilling techniques to control gas emissions, the aggressive environment and the high temperature/pressure expected from the deep fluids, and to improve knowledge of deep chemical-physical conditions for predicting and controlling critical drilling conditions. An existing well in Larderello (Tuscany, Italy), Venelle 2, will be drilled from its present depth of 2.2 km down to 3-3.5 km.

<u>DESCRAMBLE's Vision</u> is to contribute to reaching the EU strategic energy and climate targets for 2020 and 2050 by fostering increased growth in the geothermal electricity market, through increased awareness of the potential of geothermal electricity production and the demonstration of the feasibility of extracting electricity from super-critical deep geothermal reservoirs.







Deepening Venelle 2 Project: DESCRAMBLE



Enel Green Power Project Leader

Consortium members from three countries:

- CNR/IGG (Italy): geochemical and numerical modelling;
- Aachen, Kiel and Freiberg Universities (**Germany**): petrological analysis, geophysical acquisition and elaboration, numerical modeling, well log analysis and interpretation;
- > SINTEF (**Norway**), an important oil/gas research company, with experience also in drilling, instrumentation and ICT, for high pressure and temperature measuring tool and drill control techniques in severe conditions.











	Е
	S

EGP Innovation Supercritical fluids



Deepening Venelle 2 Project: DESCRAMBLE

Section 1: Drilling in super-critical conditions.

- •Definition of the drilling program: deepening the Venelle 2 well.
- •Selection/development of appropriate equipment and material to withstand the harsh downhole conditions.
- •Definition/development of drilling procedures.
- •Develop procedures for well monitoring and control in order to secure the safety of the well in terms of health and the environment.

EGP Innovation Supercritical fluids



Deepening Venelle 2 Project: DESCRAMBLE

Section 2: Geo-scientific activities to increase knowledge of supercritical wells.

- •Geophysical survey and reinterpretation of all data for a better identification of the drilling target, with a new seismic data acquisition campaign, a VSP and the accompanying deployment of seismographs in a 10-20 km area around the drill site, sounding the underground for a comprehensive and areal seismic characterization of the target horizon.
- •Definition of procedures for supercritical fluid handling and sampling; planning production test.

Supercritical fluids
EGP Innovation



Deepening Venelle 2 Project: DESCRAMBLE

Section 2: Geo-scientific activities to increase knowledge of supercritical wells.

- •Geophysical logs during drilling, to obtain a full dataset of valuable information.
- •Measurement of physical and chemical data from rock cores, cuttings and sampled fluids.
- •Characterization of the downhole environment: a logging tool will be realized to measure wellbore temperatures up to 450°C and pressures up to 50 MPa, for a minimum of 8 hours logging.




Future Perspectives Supercritical fluids exploitation



If the experin could be plar Larderello, w acceptable d reduction of t

A 30 MW ge could be real

only due to abatement d

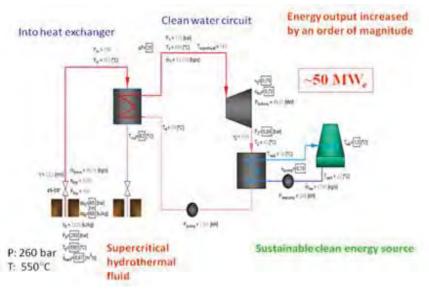

nd design of a pilot plant tothermal research in tille 2 one at an will allow a substantial

ociated reinjection one,

of a further 10% cost

The success of the research will open great perspectives both in term of increasing the installed capacity, and in term of cost reduction for the new projects.






Deep Resources:

Unconventional Geothermal Systems


(Working Group, Unione Geotermica Italiana, 2010)

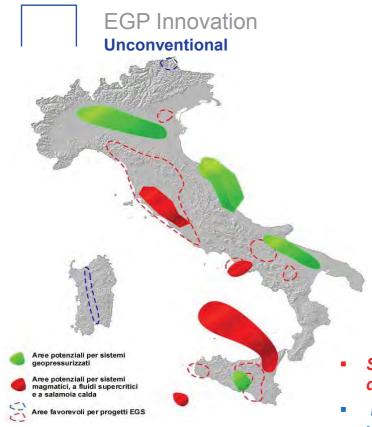



- Hot Dry Rocks Enhanced Geothermal Systems (high temperature and low-to-very low permeability)
- Pressurized systems in clastic complexes
- Hot brines, Mainly in volcanic systems. High temperature fluids at very high salinity (>> 10 g/l).
- Supercritical fluids, high temperature and depth in supercritical conditions
- Magma systems, heat capture in active volcanic areas

Unconventional Geothermal Systems (UGS), can exist in Italy at depths 2 – 5 km

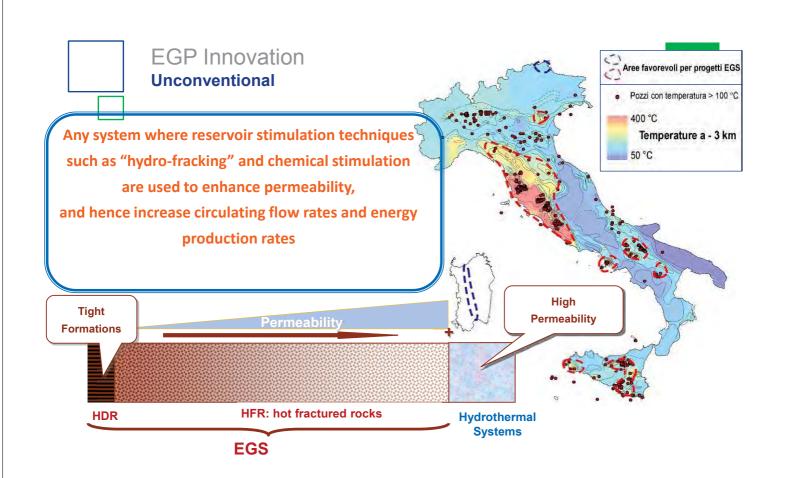





DEEP EXPLORATION METHODS

Geology, geophisics,s geochiemistruy, reservoir models

PERMEBILITY - MINING RISK

DEEP DRILLING

- High pressure and temperature
- Aggressive fluids
- Adequate materials: sensor, casing, mud, additives, cement
- Operative technology: well control and cementing

PRODUCTION

- Not conventional fluids (aggressive, flash and scaling)
- Surface plants: special materials, valve, fittings, pipes, thermal insulation
- High temperature and high pressure

EFFICIENCY OF HEAT PRODUCTION AND POWER GENERATION

- Steam group, binary groups
- Heat pipe (?), rock / well fluid heat exchange

SUSTAINABILITY

- Reinjection
- Induced sismicity
- dissolved gas management



EGP Innovation

Cascade Utilizations



Cascade Plant








Thermal Energy for heating:

- houses
- greenhouses

Process heating:

- cheese factory
- salami
- aquaculture
- beer production

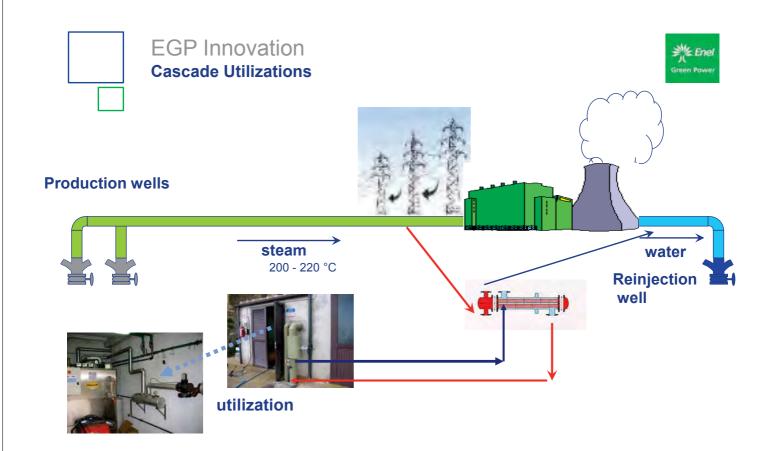







Main heater on secundary steam for Cheese factory








Salami factory

EGP Innovation



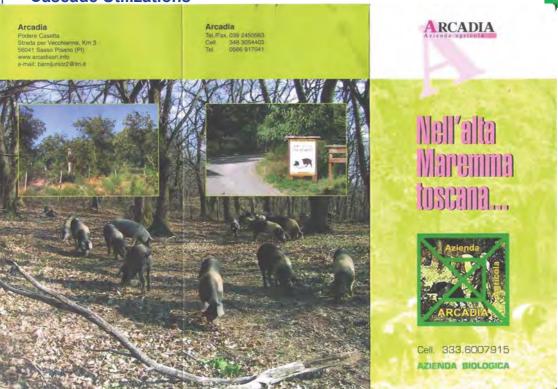







Aquaculture



EGP Innovation Cascade Utilizations





Green houses Heater







Greenhouses of Radicondoli





Greenhouses of Radicondoli








Greenhouses of Castelnuovo



Green Certificate of Origin: Branding

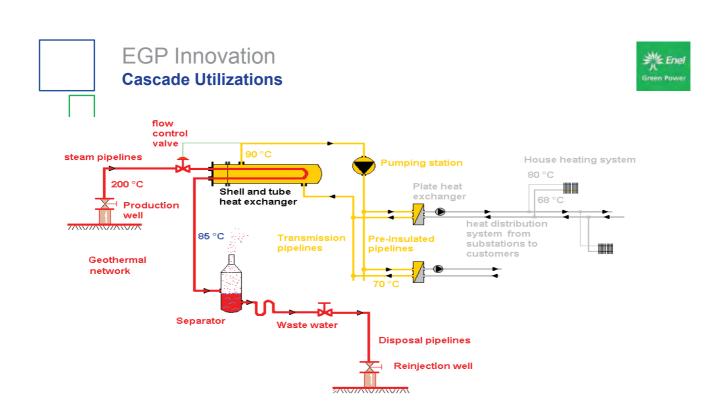



Cascade Utilizations



Forniture Calore	inizio fornitura	Potenza nominale	tipo di fluido	energia	fornita	quantità di fluido	CO ₂ evitata	uso
nome	data	Gcal/h		Gcal	ktep	kt	t	
COMUNE CASTELNUOVO V.C. (capolugo)	01/03/1986	6,24	vap. id.	19.087	1,909	38,17	5.917	Teleriscaldamento
COMUNE CASTELNUOVO V.C. (Montecastelli)	in prova	2,50	vap. id/n.id					Teleriscaldamento
ISOLVER	01/10/1987	0,15	vap. id.	150	0,015	0,30	47	Usi industriali
COMUNE POMARANCE (Ina casa)	01/11/1988	0,62	vap. id.	1.070	0,107	2,14	332	Teleriscaldamento
COSVIG ACQUACOLTURA	17/06/1993	0,64	vap. n. id.	1.368	0,137	2,74	424	Agro Alimentare
SOCIETA' CHIMICA LARDERELLO	01/08/1994	8,50	vap. id.	13.135	1,314	26,27	4.072	Usi industriali
UTENZA PRIVATA	15/10/1994	0,01	vap. id.	12	0,001	0,02	4	Teleriscaldamento
COMUNE POMARANCE (Montecerboli)	01/12/1995	3,00	vap. id.	5.669	0,567	11,34	1.757	Teleriscaldamento
UTENZA PRIVATA	20/03/1998	0,02	vap. id.	40	0,004	0,08	12	Teleriscaldamento
UTENZA PRIVATA	15/02/1999	0,01	vap. id.	20	0,002	0,04	6	Teleriscaldamento
COMUNE POMARANCE (San Dalmazio)	01/12/1999	0,60	vap. n. id.	977	0,098	1,95	303	Teleriscaldamento
LA BORACIFERA S.r.l.	01/09/2001	5,30	vap. id/n.id	3.539	0,354	7,08	1.097	Serricoltura
UTENZA PRIVATA	12/11/2001	0,03	vap. id.	29	0,003	0,06	9	Teleriscaldamento
COMUNE POMARANCE (Capoluogo)	01/01/2003	10,00	vap. id.	15.030	1,503	30,06	4.659	Teleriscaldamento
UTENZA PRIVATA	01/10/2005	0,06	vap. id.	53	0,005	0,11	16	Teleriscaldamento
UTENZA PRIVATA	01/01/2006	0,02	vap. id.	33	0,003	0,07	10	Teleriscaldamento
UTENZA PRIVATA	15/10/2008	0,06	vap. id.	96	0,010	0,19	30	Teleriscaldamento
UTENZA PRIVATA	01/10/2008	0,03	vap. id.	26	0,003	0,05	8	Teleriscaldamento
UTENZA PRIVATA	01/10/2008	0,05	vap. id.	80	0,008	0,16	25	Teleriscaldamento
UTENZA PRIVATA	01/07/2008	0,03	vap. id.	51	0,005	0,10	16	Teleriscaldamento
SEI - TR villaggi aziendali		2,84	vap. id/n.id	4.203	0,420	8,41	1.303	Teleriscaldamento
Totale Age		40,701		64.670	6,467	129,34	20.048	

Some of the Heat utilizations in Larderello



EGP Innovation

Cascade Utilizations



Forniture Calore	inizio fornitura	Potenza nominale	tipo di fluido	energia	fornita	quantità di fluido	CO ₂ evitata	uso
nome	data	Gcal/h		Gcal	ktep	kt	t	
UTENZA PRIVATA	15/10/1993	0,01	vap. id.	24	0,002	0,05	7	Teleriscaldamento
COMUNE MONTEROTONDO M.mo	14/10/1994	2,00	vap. id.	9.472	0,947	18,94	2.936	Teleriscaldamento
COMUNE POMARANCE (Lustignano)	07/03/1996	0,60	vap. n. id.	885	0,088	1,77	274	Teleriscaldamento
COMUNE POMARANCE (Serrazzano)	25/03/1996	1,70	vap. id.	2.811	0,281	5,62	871	Teleriscaldamento
COMUNE CASTELNUOVO V.C. (Sasso Pisano)	25/10/1996	2,00	vap. id/n.id	4.377	0,438	8,75	1.357	Teleriscaldamento
LA BORACIFERA S.r.l.	01/09/2001	5,30	vap. id/n.id	5.385	0,539	10,77	1.670	Serricoltura
UTENZA PRIVATA	01/03/2004	0,04	vap. n. id.	401	0,040	0,80	124	Teleriscaldamento
ARCADIA S.r.l.	01/05/2005	0,01	vap. n. id.	10	0,001	0,02	3	Agro Alimentare
SOLEMME S.p.a.	01/06/2005	2,00	vap. id.	-	1	-	-	Teleriscaldamento
UTENZA PRIVATA	01/01/2006	0,04	vap. id.	33	0,003	0,07	10	Teleriscaldamento
UTENZA PRIVATA	01/01/2006	0,03	vap. id.	25	0,003	0,05	8	Teleriscaldamento
UTENZA PRIVATA	29/05/2006	0,02	vap. id.	24	0,002	0,05	7	Teleriscaldamento
Az. Agr. LA GUARDIANA	15/10/2006	1,50	vap. id.	1.489	0,149	2,98	462	Serricoltura
Az. Agr. S. Martino	15/10/2006	0,40	vap. id.	356	0,036	0,71	110	Serricoltura
UTENZA PRIVATA	21/02/2007	0,02	vap. id.	15	0,002	0,03	5	Teleriscaldamento
UTENZA PRIVATA	21/02/2007	0,02	vap. id.	18	0,002	0,04	6	Teleriscaldamento
UTENZA PRIVATA	15/01/2007	0,02	vap. id.	71	0,007	0,14	22	Teleriscaldamento
UTENZA PRIVATA	01/12/2008	0,40	vap. id.	356	0,036	0,71	110	Agro Alimentare
UTENZA PRIVATA	01/01/2006	0,20	vap. id.	51	0,005	0,10	16	Teleriscaldamento
UTENZA PRIVATA	02/01/2009	0,73	vap. id.	121	0,012	0,24	38	Teleriscaldamento
Società Agricola La Guardiana S.r.l.	01/03/2009	3,30	vap. id.	513	0,051	1,03	159	Serricoltura
SEI - TR villaggi aziendali			vap. id/n.id	1.556	0,156	3,11	482	Teleriscaldamento
TOTALE AGE		20,342		27.992	2,799	55,98	8.678	





					fluido lenergia fornita quantità di			ı	uso
Forniture	PRO	uso	utenz	e servite	Cons	umo	rispa	CO ₂	
	VIN							evitata	
	CIA								
Calore			n°	m ³	Gcal/anno	Mwh/anno	TEP	CH ₄ [m ³]	t
COMUNE MONTIERI	GR	TR	300	90.000	5.940	6.907	594	792.000	1.841
COMUNE RADICONDOLI	SI	TR	800	240.000	15.840	18.419	1.584	2.112.000	4.910
COMUNE CHIUSDINO	SI	TR	500	150.000	9.900	11.512	990	1.320.000	3.069
COMUNE MONTEVERDI	PI	TR	800	240.000	15.840	18.419	1.584	2.112.000	4.910
MONTECASTELLI CASTELNUOVO	PI	TR	300	90.000	5.940	6.907	594	792.000	1.841
Totale Estensione			2.400	720.000	47.520	55.256	4.752	6.336.000	14.731

Some of the Heat utilizations under construction





ご清聴ありがとうございました。